


Created By: F. Jones and Nichols, Inc.
Job No: 04220855
Location: 110 Pflugerville 30 Inch Pipe Failure PRO 30 Inch Pipe Failure PRO 30 Inch Pipe Failure
Updated: Thursday, March 5, 2020 3:15 PM
User Name: 08166

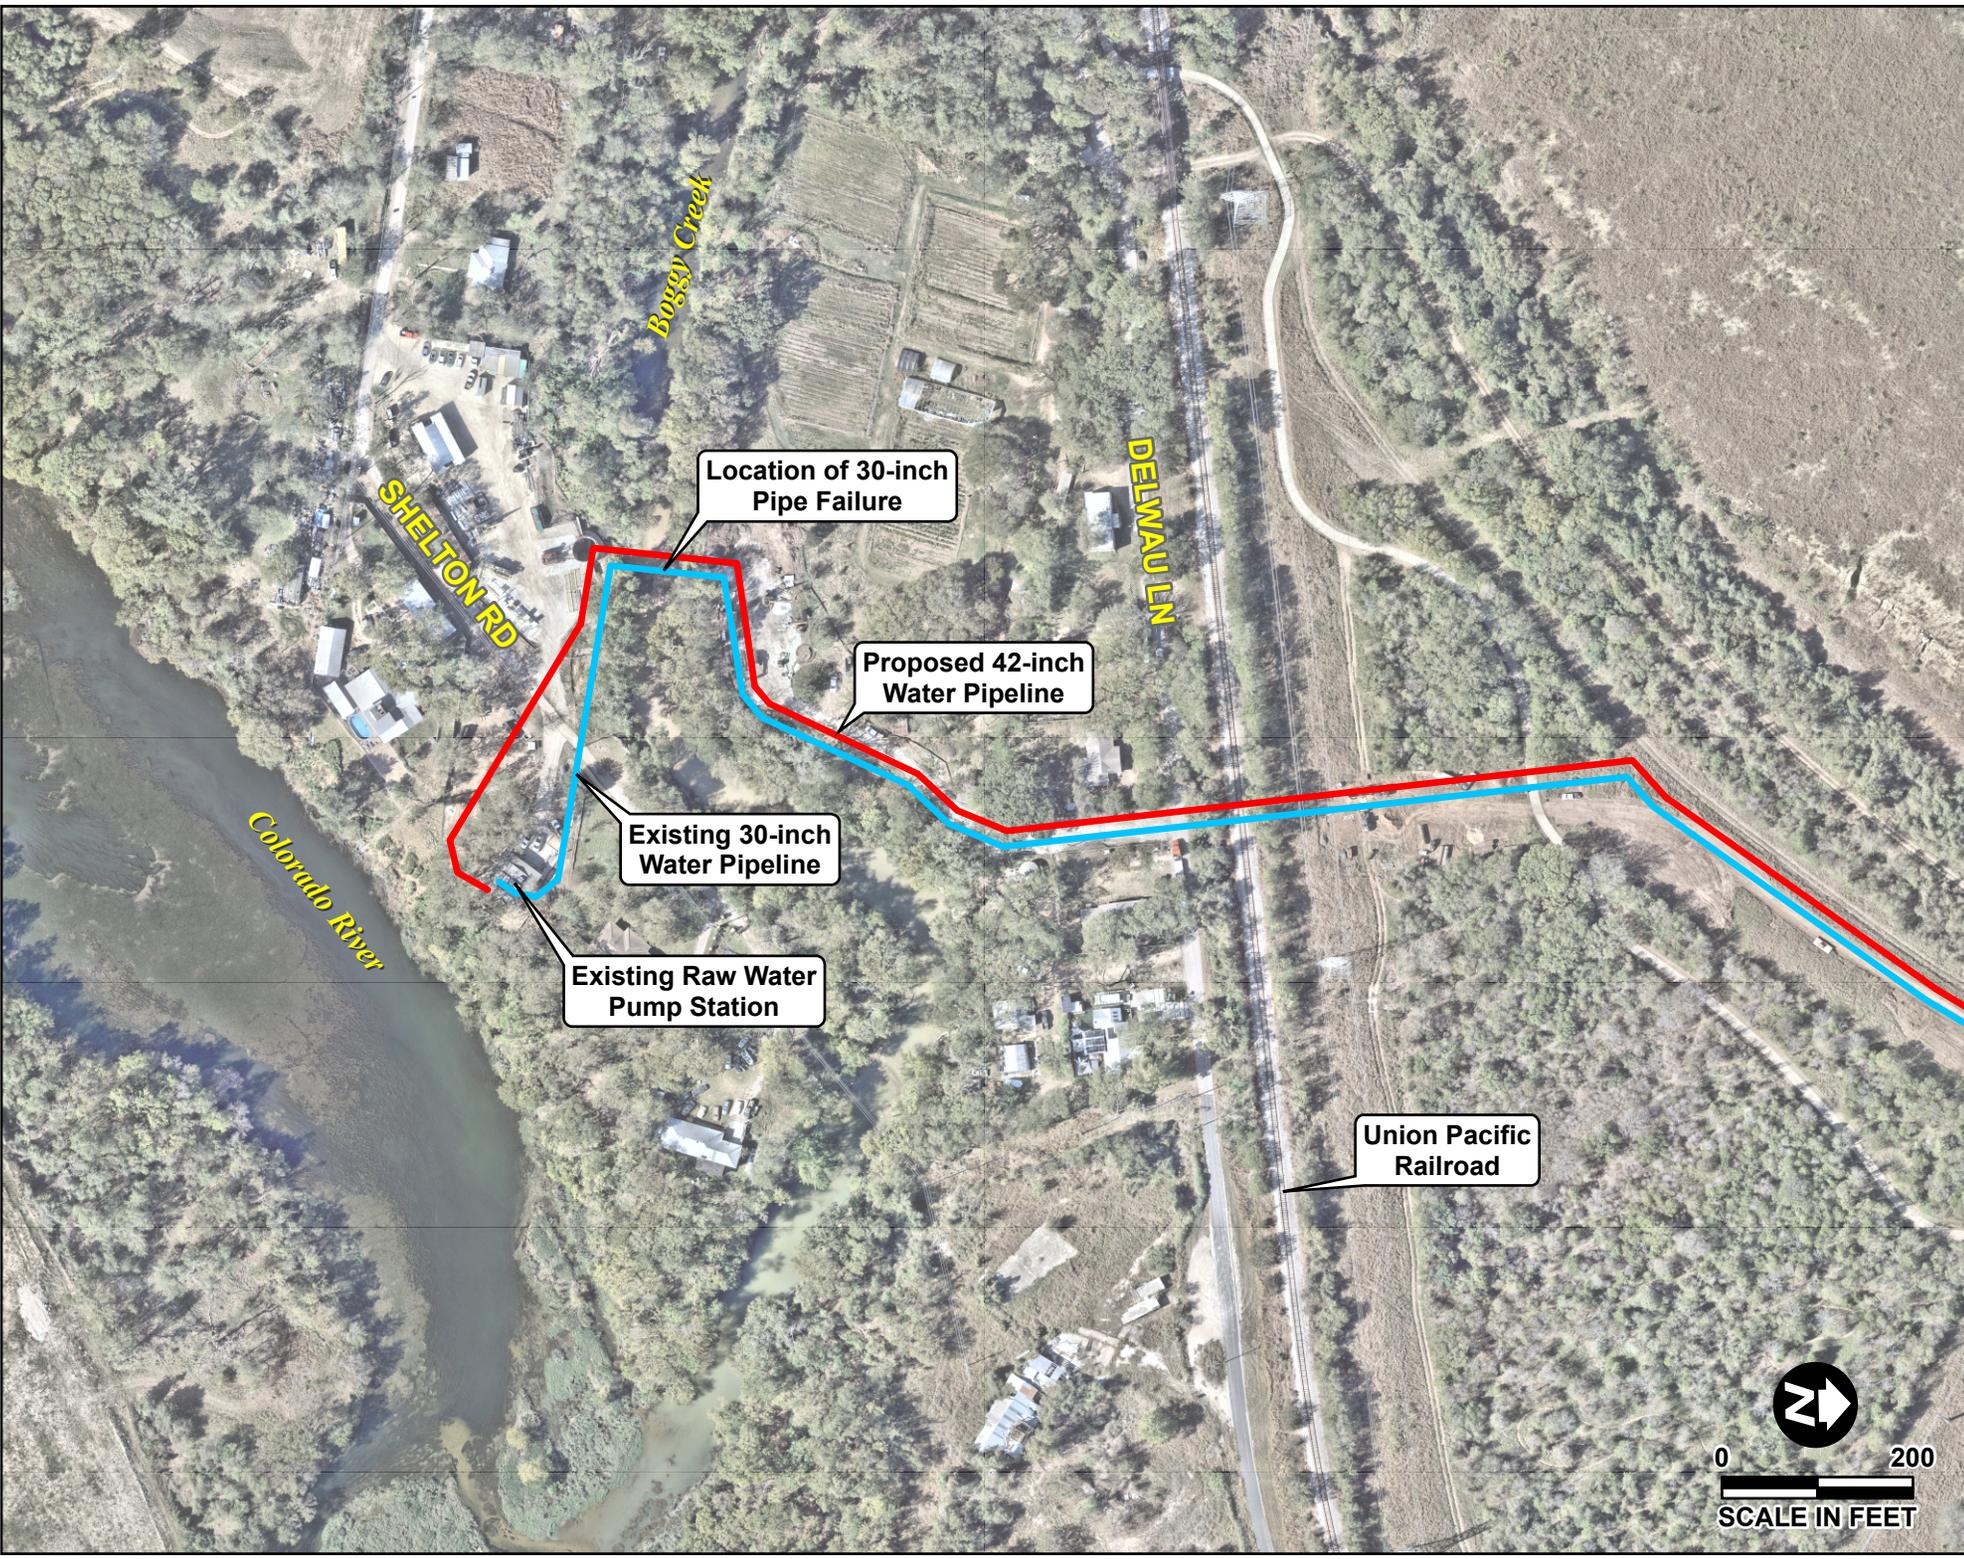

Location of 30-inch Pipe Failure

Proposed 42-inch Water Pipeline

Existing 30-inch Water Pipeline

Existing Raw Water Pump Station

Union Pacific Railroad

