


**Approving a resolution authorizing the competitive sealed proposal method for the procurement of equipment and the construction of the Secondary Colorado River Raw Water Line project, and delegating authority to use said method in accordance with the Texas Government Code.**




# Competitive Sealed Proposals

Best Value Approach to Evaluate Bids Based on:

- Price
- Experience and reputation
- Quality of goods and services
- Schedule
- Safety records
- Other relevant factors identified in bid documents

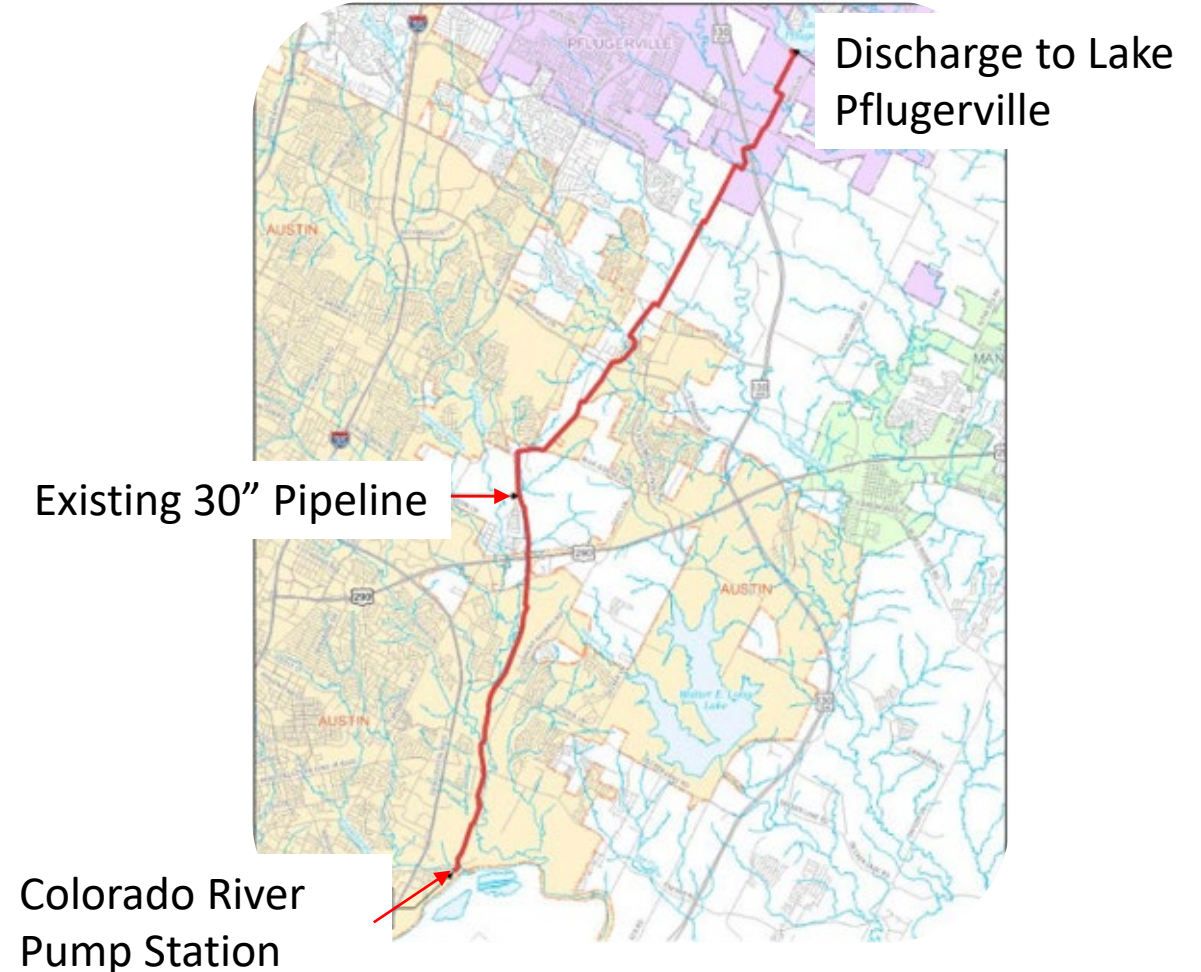

# Colorado River Raw Water Line Project

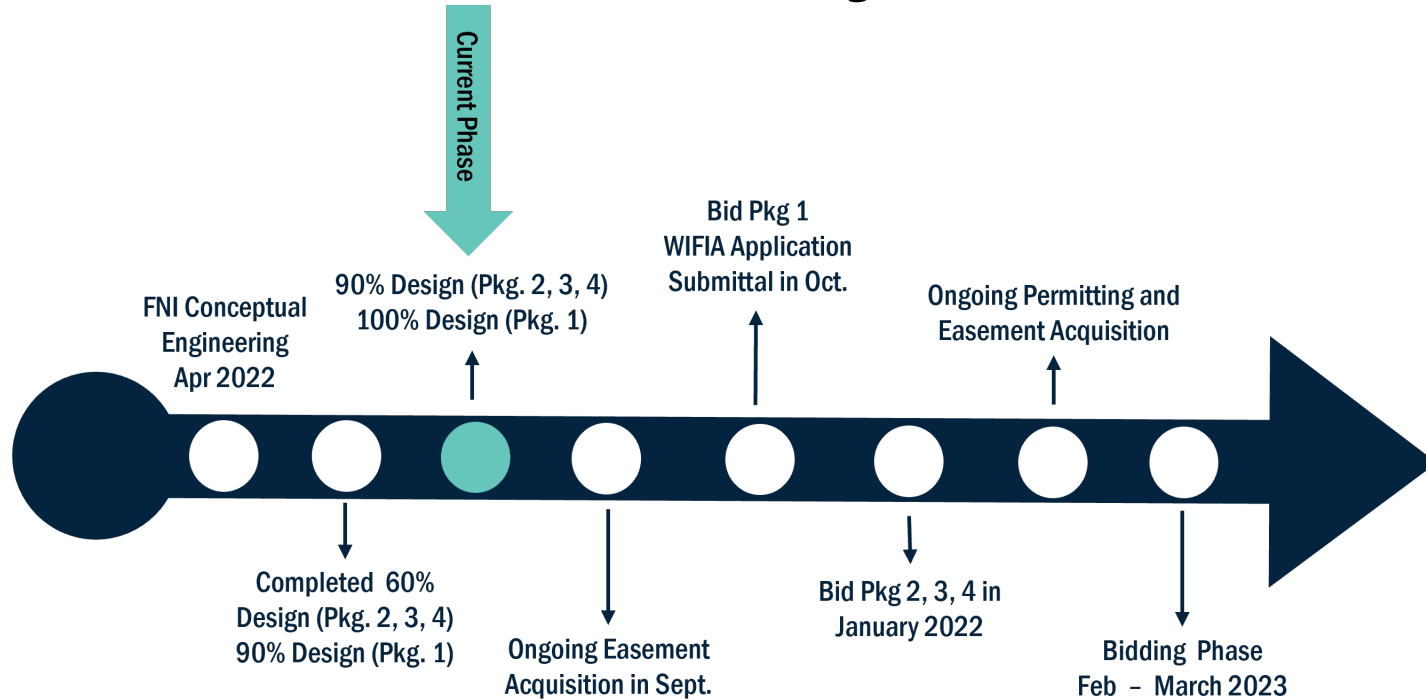

- 15 miles of 42-inch water pipeline
- Colorado River Intake Pump Station Improvements designed for capacity of 21 Million Gallons per Day at buildout
- 12,000 acre feet/year water supply increase
- Increases supply to maintain levels of Lake Pflugerville for recreation, aquatic habitat and water quality



# Recommended Action

Approve a resolution authorizing the competitive sealed proposal method for the procurement of equipment and the construction of the Secondary Colorado River Raw Water Line project

